Surface Water Management Calculations

For:

Nove of Margate City of Margate, Florida

Jeffrey T. Schnars, Professional Engineer, State of Florida, License No. 46697.
This item has been digitally signed and sealed by Jeffrey T. Schnars, P.E. on 10/16/2023.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Date: October 16, 2023

Project No. 17180

Prepared By:

Jeffrey T. Schnars, P.E.
Civil Engineer
Florida Reg. No. 6640
(FOR THE FIRM)
COA No. 6640

SCHNARS

ENGINEERING CORPORATION
947 Clint Moore Road, Boca Raton, Florida 33487
Phone: 561-241-6455
Fax: 561-241-5182

Nove of Margate Drainage Report

Project Introduction/Location

The proposed project is a redevelopment of the existing and inactive Margate Executive Golf Course into a new 132-unit residential town home community. The site is comprised of two parcels totaling 21.30 acres of land that are located on the north side of Atlantic Blvd., west of Rock Island Road and south of Margate Blvd. in the City of Margate. The entire golf course site is anticipated to be demolished to accommodate the new residential community.

Existing Conditions

This surface water management responsibility for the property lies within the governmental jurisdictional agencies of South Florida Water Management District (SFWMD), Broward County, and the City of Margate. The subject property is an inactive golf course facility and, according to our research, there are no available SFWMD permits for the properties. It appears all the surrounding lands drain through the properties including the existing Oriole Homes Golf and Tennis Club (SFWMD Permit No. 06-00144-S) north of Margate Blvd. The site has a public and City of Margate 30' drainage flowage easement. The flow must be maintained, and new flowage easements will be granted to each of the adjacent property owners. The subject properties flow south unrestricted to the SFWMD C-14 canal via the City of Margate drainage system. To establish the existing permitting criteria, a pre-development analysis of the water quality and quantity will be performed. The site will be cleared and graded to accommodate the new community. Any loss of the golf course site storage, soil storage, and an increase in the impervious area above the original conditions will require supplemental detention.

Stormwater Treatment

In accordance with SFWMD criteria, detention for water quality purposes shall be provided in the amount of 2.5 inches times the percentage of imperviousness or the first inch of runoff, whichever is greater. The water quality volume will be detained in the proposed on-site lakes and will be greater than pre-development volume. The site is located within an impaired water body discharge area and will require an additional 50% water quality detention volume and a pre-post nutrient analysis, see attached map. According to the attached BMP analysis, the pre-development nutrient loadings exceed the post development nutrient loadings and will not require additional pre-treatment.

Stormwater Attenuation

The surface water management system will consist of a series of catch basins and pipe which will direct runoff to the proposed on-site lakes that will be designed to protect the proposed finished floor elevation above the calculated 100 year-3 day zero discharge storm elevation, the elevation specified by FEMA (Zone AE) + 1 foot, the Broward County Future Conditions 100 year flood elevation, or 18 inches above the average adjacent road crown, whichever is higher. According to the SFWMD C-14 East basin criteria, off-site discharge will be limited to 69.2 CSM at the 25 year – 3 day storm event. However, since the site is currently flowing unrestricted, off-site discharge will be limited to the pre-development stages in the SFWMD C-14 canal via the existing City of Margate drainage system. The crown of the on-site roadway will be designed above the Broward County 10 year flood map elevation and the calculated 10 year - 1 day storm event elevation.



Drainage Summary

Federal Emergency Management Agency (FEMA) Flood Zones

According to the FEMA FIRM Community Panel Number 12011C0355H dated August 18, 2014, as published by the Federal Emergency Management Agency (FEMA), the site contains the following flood designations: Zone AE, base flood elevations of 10.0' and 11.0' NAVD and Zone X.

The proposed calculated stages below are consistent with the pre-development criteria as follows:

Storm Event	Pre- Dev. Flood Contour	В.С. Мар	City of Margate	This Proj. Calculated/ Proposed
Finished Floor 100year-3day	10.76'NAVD	12.50' NAVD	FEMA 11'+1' = 12.0' NAVD	10.74' NAVD 12.50' NAVD
25 year-3 day	10.02' NAVD			9.30' NAVD 9.30' NAVD
Road Crown 10 year-1 day	8.11' NAVD	10.5' NAVD		7.54' NAVD 10.50' NAVD
Discharge Allowable Proposed	Unrestricted			
Lake Design Water	5.00' NAVD	5.00' NAVD	5.00' NAVD	5.00' NAVD
Water Quality Det. & El.	1.78 ac-ft 5.92' NAVD			2.67 ac-ft 5.68' NAVD



Post-Development Surface Water Management Calculations

For:

Nove of Margate

City of Margate, Florida



Margate, Florida Schnars Engineering Corp. Project No. 17180

SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

1) SITE AREA DATA:	ACRES:		2) STAGE ELEVATIONS	: (NA	<u>(VD)</u>
Land Use			Percent: From: T	<u>0:</u>	
Buildings	3.81	Ac.	17.9% 12.50 u	ıp	
Roads/Park	2.95	Ac.	13.8% 10.30 11	1.75	
Lake	3.79	Ac.	17.8% 5.00 u	ıp	
Lake Bank	1.64	Ac.	7.7% 5.00 10	0.00	
Driveways	1.22	Ac.	5.7% 10.50 13	3.00	
Green	6.59	Ac.	30.9% 10.00 13	3.00	
S/W Courts Patios	1.30	Ac.	6.1% 10.50 13	3.00	
N/A	0.00	Ac.	<u>0.0%</u> 0.00 0.	.00	
TOTAL:	21.30	Ac.	100%		
Tatal luan amiassas	40.07		Avenage Evicting Condex 4	0.40	NA)/D
Total Impervious:	13.07 61.36%		9 9 -		NAVD
	01.30%		9 1		NAVD NAVD
Total Pervious:	8.23		(B.C. Future Cond.) Lake, Water Table: Depth to Water Table:	6.0	
Total Fervious.	38.64%		Deptil to Water Table.	0.0	IL.
2) FLOOD AND RAINFA	ALL CRITER	RIA:			
24 Hour Rainfall:					
5 Year	7.25	in.			
10 Year	8.00	in.	Min. Road Crown: 10	0.50	NAVD
25 Year	9.565	in.			
100 Year	13.245	in.	Min. Floor Elevation: 12	2.50	NAVD
Soil Storage:					
Depth to	Natural Avai	lable	Developed Available		
Water Table (ft.)	Storage (in.))	Storage (in.)		
3.00	4.40		3.30		
4.00	6.80		5.10		
Maximum Available Soil	Storage, SF	WM	D: 5.1 in. De	press	sional Sto

3) COMPUTE STAGE STORAGE: (Stage = FT, NAVD; Storage = AC-FT)

					<u>S/W</u>			
	Roads/Pa	<u>r</u>			Courts		Lake	
Stage:	<u>k</u>	<u>Driveways</u>	<u>Green</u>	<u>Lake</u>	<u>Patios</u>	<u>N/A</u>	<u>Bank</u>	Total:
5.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5.50	0.00	0.00	0.00	1.90	0.00	0.00	0.04	1.94
6.00	0.00	0.00	0.00	3.79	0.00	0.00	0.16	3.95
6.50	0.00	0.00	0.00	5.69	0.00	0.00	0.37	6.06
7.00	0.00	0.00	0.00	7.58	0.00	0.00	0.66	8.24
7.50	0.00	0.00	0.00	9.48	0.00	0.00	1.03	10.51
8.00	0.00	0.00	0.00	11.37	0.00	0.00	1.48	12.85
8.50	0.00	0.00	0.00	13.27	0.00	0.00	2.01	15.28
9.00	0.00	0.00	0.00	15.16	0.00	0.00	2.62	17.78
9.50	0.00	0.00	0.00	17.06	0.00	0.00	3.32	20.38
10.00	0.00	0.00	0.00	18.95	0.00	0.00	4.10	23.05
10.50	0.04	0.00	0.27	20.85	0.00	0.00	4.92	26.08
11.00	0.50	0.06	1.10	22.74	0.07	0.00	5.74	30.21
11.50	1.46	0.24	2.47	24.64	0.26	0.00	6.56	35.63
12.00	2.88	0.55	4.39	26.53	0.59	0.00	7.38	42.32
12.50	4.35	0.98	6.86	28.43	1.04	0.00	8.20	49.86

Margate, Florida Schnars Engineering Corp. Project No. 17180

SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

4) WATER QUALITY:

Greater of the following (5A. & 5B.) Store the first inch for the entire site or the amount of 2.5 times the percentage of imperviousness.

A. First Inch:

V = 1 in. x Total Area x 1 ft./12 in.

Total (Ac.): V = (ac-ft)21.30 1.78

B. 2.5 Times Percent Impervious:

1. Site Area = Total Area - (Lake Area + Bldg. Area)

Total (Ac.): <u>Lake:</u> <u>Bldg.:</u> <u>Site (Ac.):</u> 21.30 3.79 3.81 13.70

2. Impervious Area = Site Area - Pervious Area

Site (Ac.): Pervious: Imperv.: 8.23 5.47

3. Percent Impervious = Impervious Area / Site Area x 100

39.93 % is less than 60% and will not require dry pre

.4. 2.5 in. x % Imperv x (Total Area - Lake Area) x 1 ft./12 in.

<u>Treated (in.)</u> <u>V=(ac-ft)</u> 1.00 1.46

C. Total Required Detention:

1. The total required detention for water quality is either the first inch or 2.5 times the percent whichever is greater. The total required detention

Water Quality (ac-ft): Water Quality (Elev.):

2.67 **5.68 NAVD**

Includes 50% additional for impaired water discharge

3. Allowable C-14 Basin discharge: 69.2 CSM

Total (Ac.): Allow CFS 21.30 2.30

Margate, Florida Schnars Engineering Corp. Project No. 17180

SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

5) RUNOFF (ZERO DISCHARGE)

A. Soil Storage

1. Soil Storage (S) = Available Soil Storage x Pervious Area/Total Area (See F-1, SFWMD ERP Manual Vol.II)

 $\frac{\text{Av. Soil St.}}{5.10} \quad \frac{\text{Pervious:}}{8.23} \quad \frac{\text{Total (Ac.)}}{21.30} \quad \frac{\text{S = (in.):}}{1.97}$

B. 100 Yr.-3 Day Storm Event

Finished Floor Elevation: 12.50 NAVD

1. Rainfall - 3 Day Duration (P):

P72 = P24 x 1.359

P24 = 13.245 in. P72 = 18.00 in.

2. Runoff, Q (in.)

 $Q = {(P - 0.2 \times S)^2}/{(P + 0.8 \times S)}$

 $\frac{P72 \text{ (in.):}}{18.00}$ $\frac{S = \text{(in.):}}{1.97}$ $\frac{Q \text{ (in.):}}{15.83}$

3. Total Runoff Volume, V (ac-ft.)

 $V = Q \times Total Area \times 1 \text{ ft.} /12 \text{ in.}$

Q (in.): Total (Ac.): V=(ac-ft): 15.83 21.30 28.10

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 10.50 11.00 Interpolate Runoff between... 26.08 30.21

Stage: 10.74 NAVD

The stage is at or below the Minimum Finished Floor Elevation.

C. 25 Yr.-3 Day Storm Event (Perimeter Berm)

1. Rainfall - 3 Day Duration (P):

P72 = P24 x 1.359

P24 = 9.565 in. P72 = 13.00 in.

2. Runoff, Q (in.)

 $Q = {(P - 0.2 \times S)^2}/(P + 0.8 \times S)$

 $\frac{P72 \text{ (in.):}}{13.00}$ $\frac{S = \text{(in.):}}{1.97}$ $\frac{Q \text{ (in.):}}{10.90}$

3. Total Runoff Volume, V (ac-ft.)

 $V = Q \times Total Area \times 1 \text{ ft.} /12 \text{ in.}$

Q (in.): $\frac{\text{Total (Ac.): } \sqrt{\text{ = (ac-ft):}}}{10.90}$ 21.30 19.35

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 9.00 9.50 Interpolate Runoff between... 17.78 20.38

Stage: 9.30 NAVD

Margate, Florida
Schnars Engineering Corp. Project No. 17180

SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

D. 10 Yr.-1 Day Storm Event (Roadway Criteria)

1. Rainfall - 1 Day Duration (P):

P24 = 8.00 in.

2. Runoff, Q (in.)

 $Q = {(P - 0.2 \times S)^2}/(P + 0.8 \times S)$

 $\frac{\text{P24 (in.):}}{8.00}$ $\frac{\text{S = (in.):}}{1.97}$ $\frac{\text{Q (in.):}}{6.04}$

3. Total Runoff Volume, V (ac-ft.)

 $V = Q \times Total Area \times 1 \text{ ft.} /12 \text{ in.}$

 $\frac{Q \text{ (in.):}}{6.04}$ $\frac{\text{Total (Ac.): } \sqrt{\text{ = (ac-ft):}}}{21.30}$ $\frac{10.72}{10.72}$

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 7.50 8.00 Interpolate Runoff between... 10.51 12.85

Stage: 7.54 NAVD

E. 5 Yr.-1 Day Storm Event

Minimum Road Crown Elev: 10.50 NAVD

1. Rainfall - 1 Day Duration (P):

P24 = 7.25 in.

2. Runoff, Q (in.)

 $Q = {(P - 0.2 \times S)^2}/{(P + 0.8 \times S)}$

 $\frac{\text{P24 (in.):}}{7.25}$ $\frac{\text{S = (in.):}}{1.97}$ $\frac{\text{Q (in.):}}{5.33}$

3. Total Runoff Volume, V (ac-ft.)

 $V = Q \times Total Area \times 1 \text{ ft.} /12 \text{ in.}$

Q (in.): Total (Ac.): / = (ac-ft): 5.33 21.30 9.46

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 7.00 7.50 Interpolate Runoff between... 8.24 10.51

Stage: 7.27 NAVD

The stage is at or below the Minimum Road Crown Elevation.

Margate, Florida Schnars Engineering Corp. Project No. 17180

SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

6) SITE AREA BREAKDOWN:

Land Use	<u>Pervious</u>	<u>Impervious</u>	<u>Total</u>
Buildings	0.00 Ac.	3.81 Ac.	3.81 Ac.
Roads/Park	0.00 Ac.	2.95 Ac.	2.95 Ac.
Lake	0.00 Ac.	3.79 Ac.	3.79 Ac.
Lake Bank	1.64 Ac.	0.00 Ac.	1.64 Ac.
Driveways	0.00 Ac.	1.22 Ac.	1.22 Ac.
Green	6.59 Ac.	0.00 Ac.	6.59 Ac.
S/W Courts F	0.00 Ac.	1.30 Ac.	1.30 Ac.
N/A	<u>0.00</u> Ac.	<u>0.00</u> Ac.	<u>0.00</u> Ac.
Totals:	8.23 Ac.	13.07 Ac.	21.30 Ac.

7) SUMMARY

Required Water Quality Storage: 2.67 ac-ft

Site Soil Storage: 1.97 in

B.C. 100 yr. Future Cond. Flood Map El.: 12.5' NAVD

FEMA 100 yr. 2021 Flood Map El.: Flood Zone AE (11.0') NAVD

City of Margate Min. FF El.: AE (11.0) + 1' NAVD

B.C. 10 yr. Flood Map El.: 10.5' NAVD

POST DEVELOPMENT ZERO DISCHARGE

5 Yr1 Day Storm:	9.46	ac-ft	7.27	NAVD Stage Elevation
10 Yr1 Day Storm:	10.72	ac-ft	7.54	NAVD Stage Elevation
25 Yr3 Day Storm:	19.35	ac-ft	9.30	NAVD Stage Elevation
100 Yr3 Day Storm:	28.10	ac-ft	10.74	NAVD Stage Elevation

FLOOD ROUTINGS

5 Yr1 Day Storm:	N/A NAVD	N/A cfs Disch.
10 Yr1 Day Storm:	N/A NAVD	N/A cfs Disch.
25 Yr3 Day Storm:	N/A NAVD	N/A cfs Disch.

<u>DATE PRINTED:</u> <u>PREPARED BY:</u> <u>REVISED BY:</u> <u>DATE:</u> 16-Oct-23 JWM JTS

Pre-Development Surface Water Management Calculations

For:

Nove of Margate

City of Margate, Florida



Margate, Florida Project No. 17180

PRE-DEVELOPMENT SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

1) SITE DATA:	ACRES:	2) STAGE ELEVATION	NS (NAVD)	<u>):</u>
Landuse		Percent: From:	To:	
Buildings	0.01 Ac.	0.0%		
Pavement	0.60 Ac.	2.8%		
Lake	1.80 Ac.	8.5%		
Lake Bank	0.82 Ac.	3.8%		
Green	18.07 Ac.	84.8%		
Lots	0.00 Ac.	0.0%		
N/A	0.00 Ac.	0.0%		
N/A	0.00 Ac.	<u>0.0%</u>		
TOTAL AREA:	21.30 Ac.	100%		
Total Impervious:	2.41 11.31%	Average Existing Grade: Average Proposed Grade: Lake, Water Table:	10.66 11.00 5.00	
Total Pervious:	18.89 88.69%			
2) FLOOD AND RAINF	ALL CRITERIA:			
24 Hour Rainfall: 10 Year 25 Year 100 Year	8.00 in. 9.57 in. 13.245 in.	Min. Road Crown: Min. Floor Elev:	10.09 11.89	NAVD NAVD
Maximum Available Soi	l Storage, SFWMD:	5.1 in.	Depression	nal Storage

3) COMPUTE STAGE STORAGE: (Stage = FT, NAVD; Storage = AC-FT)

Stage:	<u>Pavement</u>	<u>Green</u>	<u>Lots</u>	<u>Lake</u>	<u>N/A</u>	N/A Lake Bank	<u>Total:</u>
5.00							0.00
5.50							0.97
6.00							2.05
6.50							3.22
7.00	Se	e Geopak ca	Iculations				4.49
7.50							5.86
8.00							7.33
8.50							8.92
9.00							10.66
9.50							12.68
10.00							15.45
10.50							20.02
11.00							26.81
11.50							35.14
12.00							44.37
							54.12

Margate, Florida Project No. 17180

PRE-DEVELOPMENT SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

4) WATER QUALITY:

Greater of the following (4A and 4B) Store the first inch for the entire site or the amount of 2.5 times the percentage of imperviousness.

A. First Inch:

V = 1 in. x Total Area x 1 ft./12 in.

Total (Ac.): V = (ac-ft)21.30 1.78

B. 2.5 Times Percent Impervious:

1. Site Area = Total Area - (Lake Area + Bldg. Area)

<u>Total (Ac.):</u> <u>Lake:</u> <u>Bldg.:</u> <u>Site (Ac.):</u> 21.30 1.80 0.01 19.49

2. Impervious Area = Site Area - Pervious Area

<u>Site (Ac.):</u> <u>Pervious:</u> <u>Imperv.:</u> 19.49 18.89 0.60

3. 2.5 in. x Imperv./Site x Total Area x 1 ft./12 in.

<u>Imperv.:</u> V=(ac-ft) 0.6 0.14

C. Total Required Detention:

1. The total required detention for water quality is either the first inch or 2.5 times the percent impervio whichever is greater. The total required detention is:

Water Quality (ac-ft): Water Quality (elev): 5.92

5) RUNOFF (ZERO DISCHARGE)

A. Soil Storage

 Soil Storage (S) = Available Soil Storage x Pervious Area/Total Area (See C-35, SFWMD Vol.IV)

Av. Soil St. Pervious: Total (Ac.): S = (in.): 5.10 18.89 21.30 4.52

Margate, Florida Project No. 17180

11.89 NAVD

PRE-DEVELOPMENT SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

B. 100 Yr.-3 Day Storm Event

Finished Floor Elevation:

1. Rainfall - 3 Day Duration (P):

P24 = 13.245 in. P72 = 18.00 in.

2. Runoff, Q (in.)

$$Q = {(P - 0.2 \times S)^2}/(P + 0.8 \times S)$$

$$\frac{P72 \text{ (in.):}}{18.00}$$
 $\frac{S = \text{(in.):}}{4.52}$ $\frac{Q \text{ (in.):}}{13.52}$

3. Total Runoff Volume, V (ac-ft.)

V = Q x Total Area x 1 ft. /12 in.

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 10.50 11.50 Interpolate Runoff between... 20.02 35.14

Stage: 10.76

The stage is at or below the Minimum Finished Floor Elevation.

C. 25 Yr.-3 Day Storm Event (Basin Design)

1. Rainfall - 3 Day Duration (P):

2. Runoff, Q (in.)

$$Q = {(P - 0.2 \times S)^2}/(P + 0.8 \times S)$$

$$\frac{P72 \text{ (in.):}}{13.01} \quad \frac{S = \text{(in.):}}{4.52} \quad \frac{Q \text{ (in.):}}{8.81}$$

3. Total Runoff Volume, V (ac-ft.)

 $V = Q \times Total Area \times 1 \text{ ft. } /12 \text{ in.}$

$$\frac{Q \text{ (in.):}}{8.81}$$
 $\frac{\text{Total (Ac.):}}{21.30}$ $\frac{\text{V = (ac-ft):}}{15.64}$

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 10.00 11.00 Interpolate Runoff between... 15.45 26.81

Stage: 10.02

Margate, Florida Project No. 17180

PRE-DEVELOPMENT SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

D. 10 Yr.-1 Day Storm Event (Local Road Criteria)

Min. Road Elevation

10.09 NAVD

1. Rainfall - 1 Day Duration (P):

P24 = 8.00 in.

2. Runoff, Q (in.)

 $Q = {(P - 0.2 \times S)^2}/(P + 0.8 \times S)$

 $\frac{\text{P24 (in.):}}{8.00}$ $\frac{\text{S = (in.):}}{4.52}$ $\frac{\text{Q (in.):}}{4.33}$

3. Total Runoff Volume, V (ac-ft.)

 $V = Q \times Total Area \times 1 \text{ ft.} /12 \text{ in.}$

 $\frac{Q \text{ (in.):}}{4.33}$ $\frac{\text{Total (Ac.):}}{21.30}$ $\frac{\text{V = (ac-ft):}}{7.69}$

4. From the Stage - Storage Curve, the zero discharge elevation is:

Interpolate Stage between... 8.00 9.00 Interpolate Runoff between... 7.33 10.66

Stage: 8.11

The stage is at or below the Minimum Road Crown Elevation.

6) SUMMARY

Required WQ Storage: 1.78 ac-ft

Soil Storage: 4.52 in

ZERO DISCHARGE

10 Yr.-1 Day Storm:7.69 ac-ft8.11 NAVD Stage Elevation25 Yr.-3 Day Storm:15.64 ac-ft10.02 NAVD Stage Elevation100 Yr.-3 Day Storm:24.00 ac-ft10.76 NAVD Stage Elevation

FLOOD ROUTING

10 Yr.-1 Day Storm: N/A NAVD N/A cfs Disch. 25 Yr.-3 Day Storm: N/A NAVD N/A cfs Disch.

<u>DATE PRINTED:</u> <u>PREPARED BY:</u> <u>REVISED BY:</u> <u>DATE:</u>

16-Oct-23 JTS

Margate, Florida Project No. 17180

PRE-DEVELOPMENT SFWMD SURFACE WATER MANAGEMENT CALCULATIONS

7) Site Data Breakdown:

Landuse	Pervious		<u>Impervi</u>	<u>ous</u>	<u>Total</u>	
Buildings	0.00 A	Ąс.	0.01	Ac.	0.01	Ac.
Pavement	0.00	٩c.	0.60	Ac.	0.60	Ac.
Lake	0.00	٩c.	1.80	Ac.	1.80	Ac.
Lake Bank	0.82 A	٩c.	0.00	Ac.	0.82	Ac.
Green	18.07 <i>A</i>	٩c.	0.00	Ac.	18.07	Ac.
Lots	0.00	٩c.	0.00	Ac.	0.00	Ac.
N/A	0.00 A	٩c.	0.00	Ac.	0.00	Ac.
N/A	<u>0.00</u> A	\с .	0.00	<u>Ac.</u>	0.00	Ac.
Totals:	18.89	Ac.	2.41	Ac.	21.30	Ac.


```
**************************
** Plane To TIN Volume Report -- Thu May 19 12:57:29 2022
**
                                                            **
** From Elevation <14.000> to TIN <17180_exist.tin>
**
                                                            **
** Prismoidal Volume
**
**********************************
**
**
   Total Cut =
                      137459.332 Cubic Yards
** Total Fill =
                      65.547 Cubic Yards
**
   Area =
                      103136.983 Sq Yards
**
   Balance =
                      137393.784 Cubic Yards
** Elevation Range Used
** 5.000 to 5.500
                      Cut = 1569.229 Fill = 0.000
** 5.500 to 6.000
                      Cut = 1735.793 Fill = 0.000
** 6.000 to 6.500
                      Cut = 1890.626 Fill = 0.000
** 6.500 to 7.000
                      Cut = 2047.476 Fill = 0.000
** 7.000 to 7.500
                      Cut = 2208.864 Fill = 0.000
** 7.500 to 8.000
                      Cut = 2380.507 Fill = 0.000
** 8.000 to 8.500
                      Cut = 2565.731
                                    Fill = 0.000
** 8.500 to 9.000
                      Cut = 2802.417 Fill = 0.000
** 9.000 to 9.500
                      Cut = 3262.699
                                    Fill = 0.000
** 9.500 to 10.000
                      Cut = 4456.444  Fill = 0.000
** 10.000 to 10.500
                      Cut = 7386.815 Fill = 0.000
** 10.500 to 11.000
                      Cut = 10945.905
                                            Fill = 0.000
                      Cut = 13434.684
** 11.000 to 11.500
                                            Fill = 0.000
** 11.500 to 12.000
                      Cut = 14892.138
                                            Fill = 0.000
** 12.000 to 12.500
                      Cut = 15737.449
                                            Fill = 0.000
** 12.500 to 13.000
                    Cut = 16353.457
                                            Fill = 0.000
** 13.000 to 13.500
                                            Fill = 0.000
                      Cut = 16783.196
** 13.500 to 14.000
                      Cut = 17004.024
                                            Fill = 0.000
**
                                                            **
** Boundary Polygon Used
**************************
```

City of Margate, Florida

"Maps"



Future Conditions Average Wet Season Groundwater Elevation Map

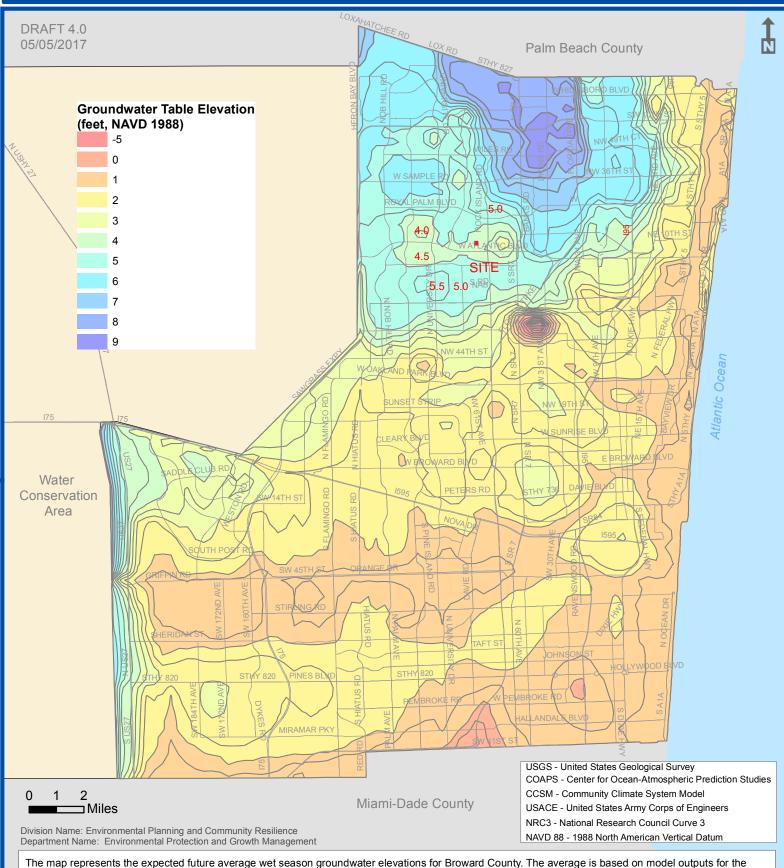


The map represents the expected future average wet season groundwater elevations for Broward County. The average is based on model outputs for the months of May through October over the period of 2060-2069. The models used are The Broward County Inundation Model and the Broward County Northern Variable Density model, both developed by the USGS and MODFLOW based. The future conditions that are modified in the models are both precipitation and sea level rise. The future precipitation pattern is based on the COAPS downscaled CCSM global model and represents an increase of 9.1% rainfall from the base case of 1990-1999 (53.4 in/yr to 58.2 in/yr). Sea level rise was based on the USACE NRC3 curve which equates to an increase of 26.6 to 33.9 inches to the future period from 1992 levels. Final results are presented in NAVD 88.

This map is for planning purposes and should not be used for legal boundary determinations.

Future Conditions Groundwater Elevation

Average Wet Season

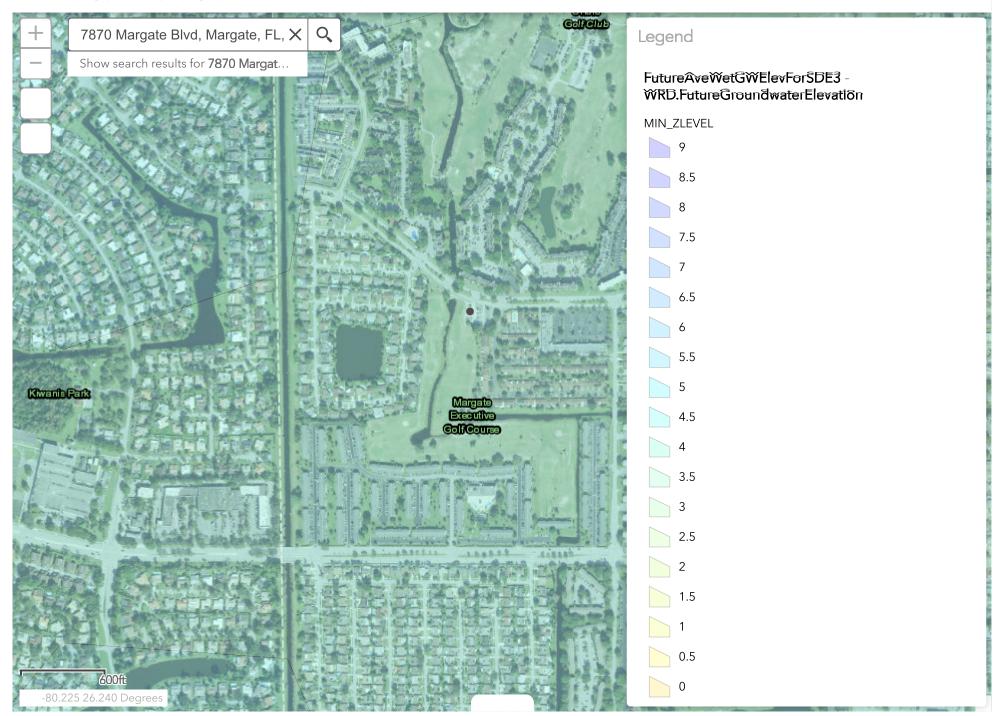

Appendix A: SFWMD - ALLOWABLE DISCHARGE FORMULAS

Canal	Allowable Runoff	<u>Design</u> Frequency
C-1	$Q = (\frac{112}{\sqrt{100}} + 31) A$	10 year
C-2	√A Essentially unlimited inflow by gravity connections southeast of Sunset Drive: 54 CSM northwest of Sunset Drive	200 year +
C-4	Essentially unlimited inflow by gravity connections east of S.W. 87 th Avenue	200 year +
C-6	Essentially unlimited inflow by gravity connections east of FEC Railroad	200 year +
C-7	Essentially unlimited inflow by gravity connection	100 year +
C-8 C-9	Essentially unlimited inflow by gravity connection Essentially unlimited inflow by gravity connection east	200 year +
	of Red Road; 20 CSM pumped, unlimited gravity with development limitations west of Red Road or Flamingo Blvd.	100 year +
C-10		200 year +
C-11	20 CSM west of 13A;40 CSM east of 13A	25 voor
C-12 C-13	90.6 CSM 75.9 CSM	25 year 25 year
C-14	69.2 CSM	25 year
C-15	70.0 CSM	25 year
C-16	62.6 CSM	25 year
C-17	62.7 CSM	25 year
C-18	41.6 CSM	25 year
C-19	57.8 CSM	
C-23	31.5 CSM	10 year
C-24	30.25 CSM	10 year
C-25	$Q = (\frac{47}{\sqrt{A}} + 28) A \text{ (Under Review)}$	10 year
C-38	31.1 CSM (subject to restrictions of Basin Rule)	10 year
C-40, 41, 41A	35.4 CSM	10 year
Hillsboro Canal (east of S-39)	35 CSM	25 year
North New River (east of S-34)	70.8 CSM	25 year
Everglades Ag. Area (all canals)	20 CSM	5 year
L-28	11.8 CSM	
C-51	35 CSM east of Turnpike; 27 CSM west of Turnpike (subject to restrictions of Basin Rule)	10 year
C-100, 100A, 100B,	Q = (104 + 43) A	40
100C, 100D:	\sqrt{A}	10 year
C-102	$Q = (\frac{119}{\sqrt{A}} + 25) A$	10 year
C-103N, C103-S	Q = (107 + 39) A	10 year

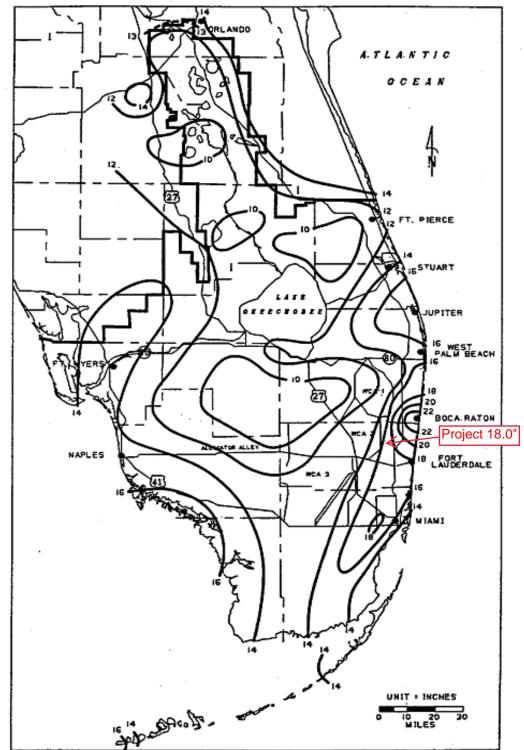


FIGURE C-9. 3-DAY RAINFALL: 100-YEAR RETURN PERIOD

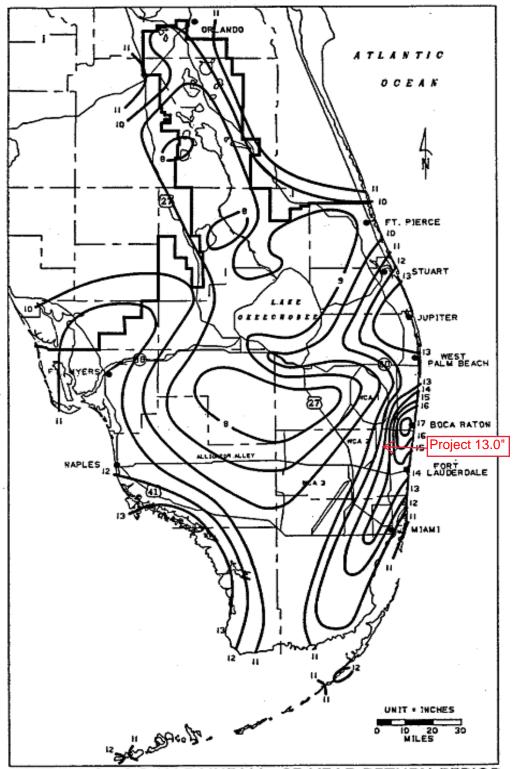


FIGURE C-8. 3-DAY RAINFALL: 25-YEAR RETURN PERIOD

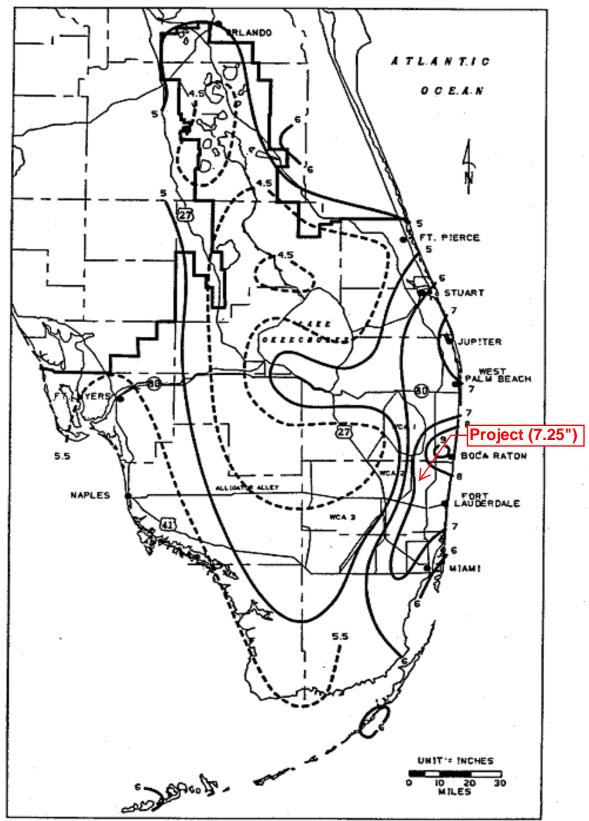


FIGURE C-3. 1-DAY RAINFALL: 5-YEAR RETURN PERIOD


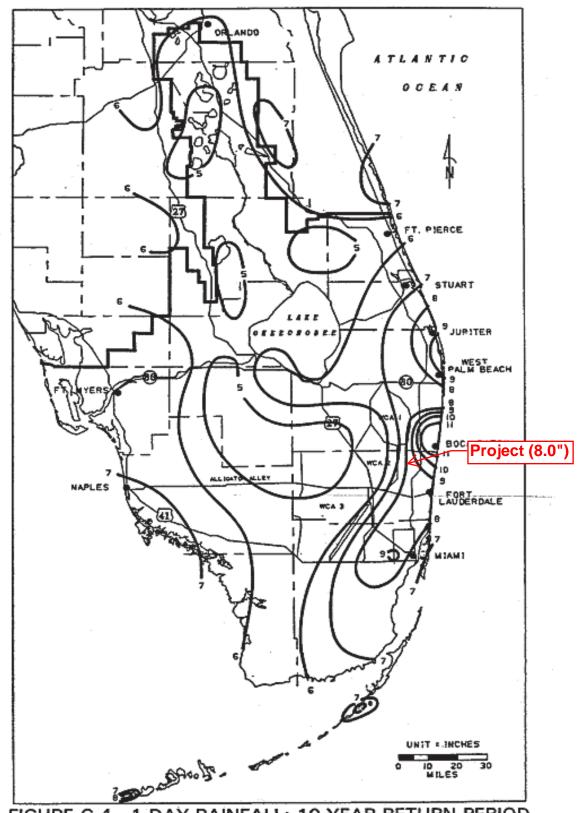



FIGURE C-4. 1-DAY RAINFALL: 10-YEAR RETURN PERIOD

Future Conditions 100-Year Flood Map 2060



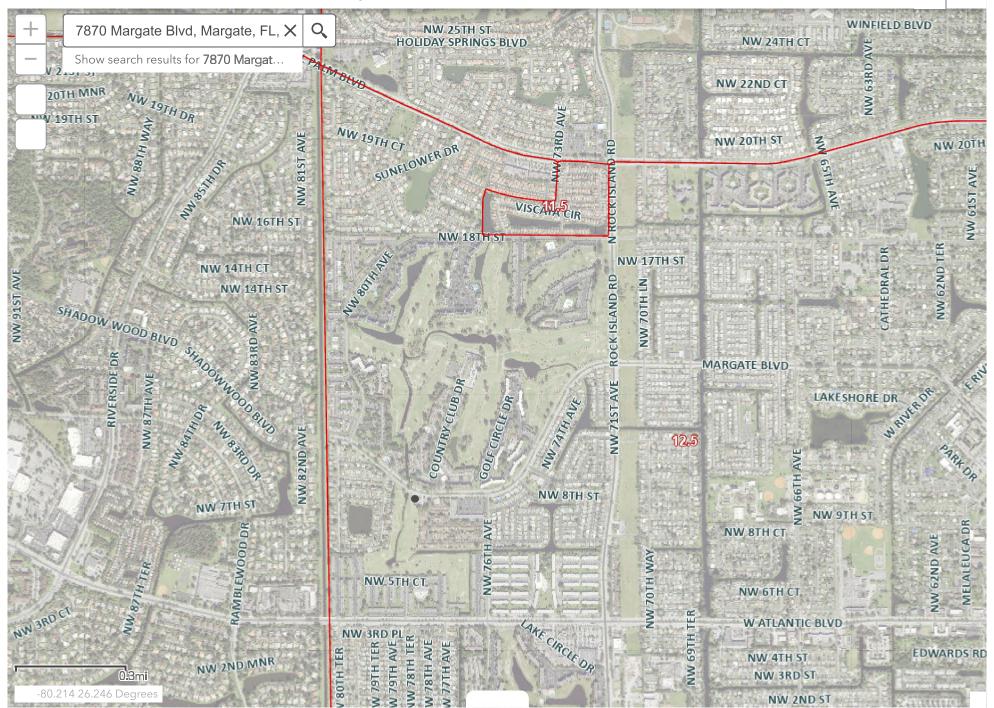

Drainage Districts Broward County, Florida

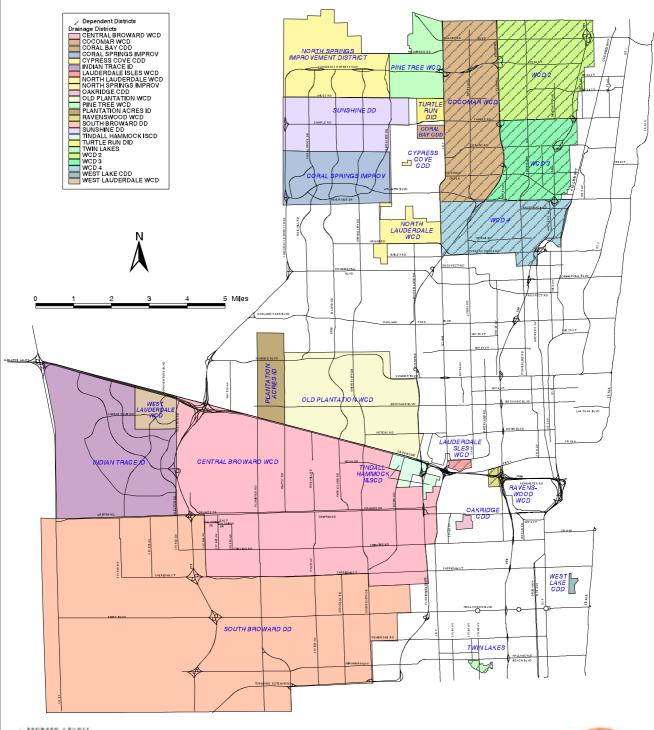



Broward County Department of Planning and Environmental Protection Geographic Information Systems Water Resources Division



Drainage Basins PALM BEACH COUNTY SAWGRASS EXPRESSWAY HILLSBORO POMP ANO CANAL C-14 WEST C-14 EAST FT. LAUDERDALE 5 Miles NFMR C-13 WEST C-13 EAST NNR CANAL WESTERBLYD C-12 SADDLE CLUB RD NNR CANAL EAST C-11 WEST C-11 EAST COAST DANIA BEACH BLVD **CONSERVATION AREA** C-10 C-9 EAST C-9 WEST MIAMI-DADE COUNTY




Broward County Department of Planning & Environmental Protection Geographic Information Systems

March, 2000




BROWARD COUNTY LAND USE PLAN

Natural Resource Map Series- Eastern Broward County: Soils

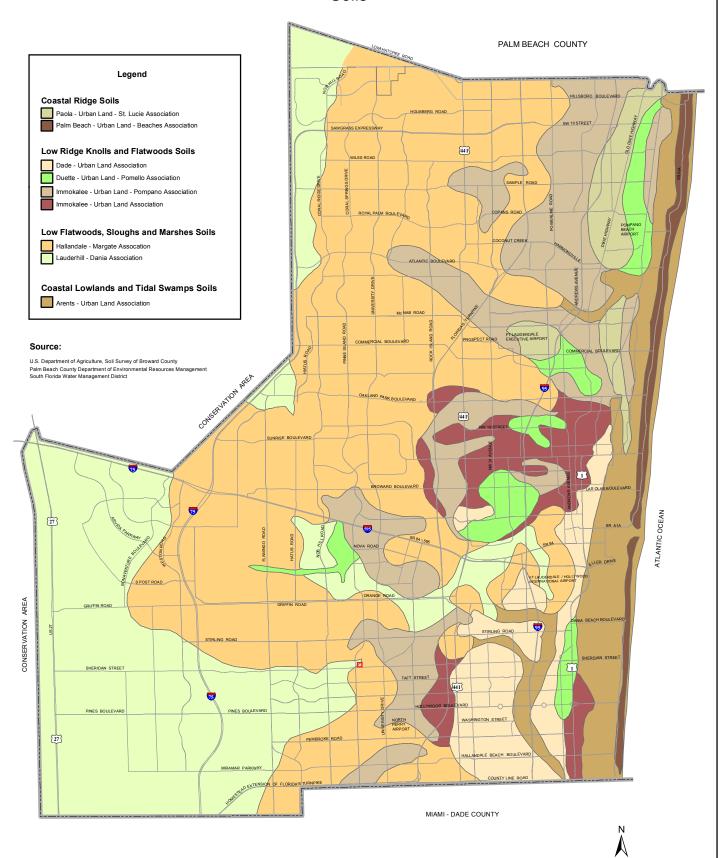




Broward County Wellfield Map Broward County Board of County Commissioners Chapter 27- Article XIII Rule of 6/11/2013

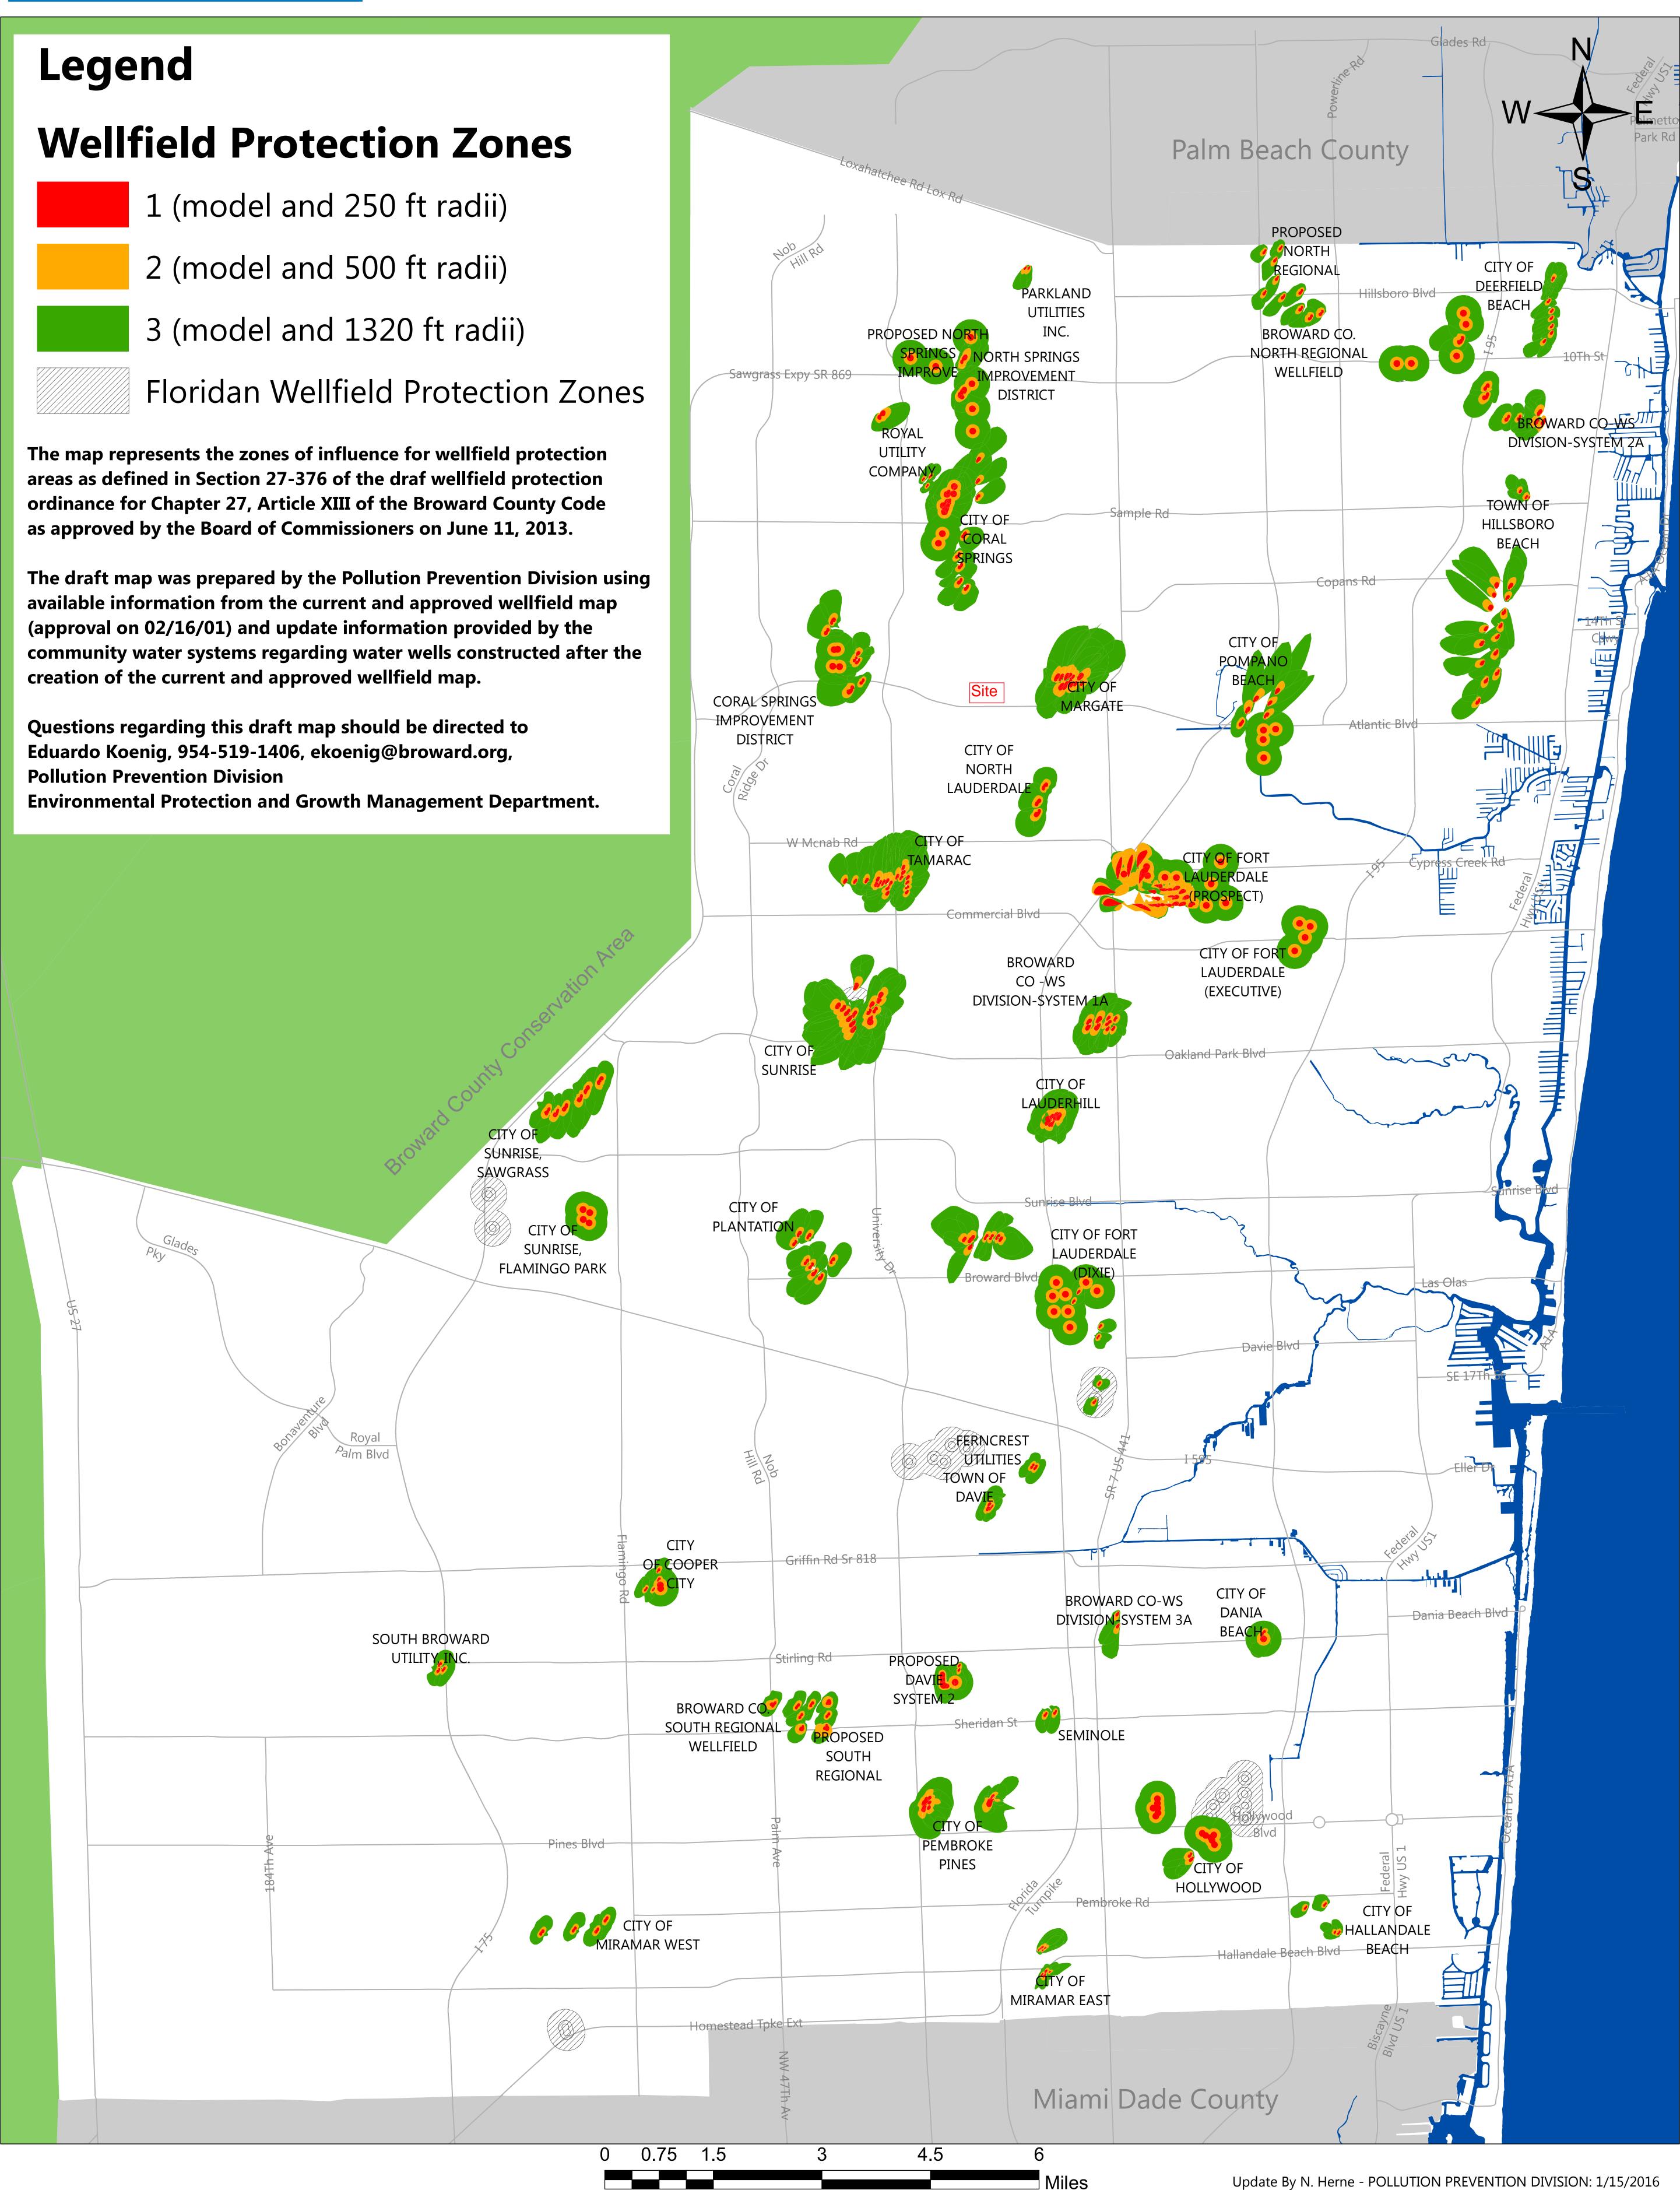

National Flood Hazard Layer FIRMette




Basemap: USGS National Map: Orthoimagery: Data refreshed October, 2020

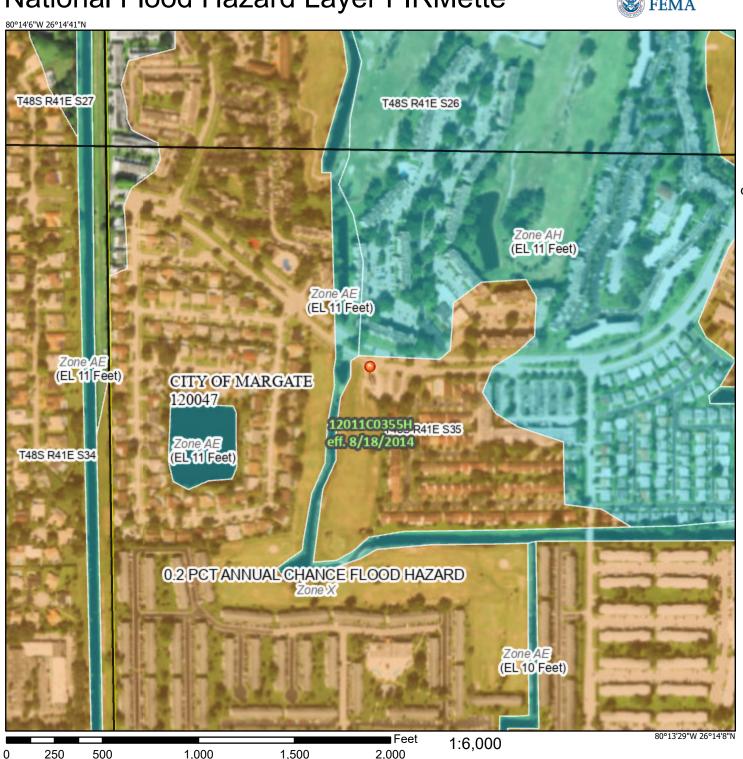

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

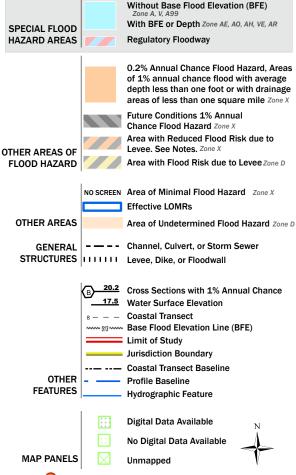

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The pin displayed on the map is an approximate point selected by the user and does not represent

an authoritative property location.

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 6/15/2022 at 3:45 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

Home ♥ Water Quality Assessments, TMDLs, and BMAPs

