

DRAINAGE CALCULATIONS

**Popeye's Margate
750 State Road 7
Margate, Florida**

**Prepared by:
Atlantic Engineering Services, Inc.
2822 Waters Edge Circle
Greenacres, Florida 33413
Ph: 561-358-4140
Fax: 561-922-6765
atlanticengserv@gmail.com**



**Imtiaz Ahmed, P.E.
Florida License # 46102
April 26, 2018**

POPEYES MARGATE, FLORIDA

1) PROPOSED LAND USE

PROJECT PHASE	AREA (ACRES)	BUILDING (ACRES)		PAVED COVERAGE (ACRES)		TOTAL IMPERVIOUS (ACRES)	
0	0.97	0.05	5.06%	0.45	45.96%	0.49	51.0%
TOTAL	0.97	0.05		0.45		0.49	

Site Area.....	0.97 acres
Net Area.....	0.97 acres
Building Area.....	0.05 acres
Paved Coverage.....	0.45 acres
Green Area.....	0.47 acres

2) FLOOD AND RAINFALL CRITERIA

5 year, 1 hour storm.....	3.10 inches		
5 year, 1 day storm.....	6.50 inches		
10 year, 1 day storm.....	8.50 inches	Minimum road crown.....	10.00 navd
25 year, 1 day storm.....	10.50 inches		
100 year, 3 day storm.....	17.67 inches	Finish Floor Elev.	11.50 navd

3) COMPUTE SOIL STORAGE

Wet season water elev.....	3.00 navd
Ave. groundwater elev.....	3.00 navd
Ave. site elevation.....	10.50 navd
Depth to water table.....	7.50 ft.

Assuming 25% compaction, available ground storage is.....	6.75 inches
Storage available in pervious areas of the site is	0.27 acre ft.
Converting to site wide moisture storage,S	3.31 inches

4) WATER QUALITY REQUIREMENTS

i) Based on the first 1" of runoff

Site area.....	0.97 acres
Required detention.....	0.08 acre ft.

ii) Based on 2.5 inches times percent impervious

Site area.....	0.92 acres (Excluding building areas)
Impervious area.....	0.45 acres (Excluding building areas)
Percent impervious.....	48.41 %
Required detention.....	0.10 acre ft.

Therefore the required detention is..... 0.10 acre ft. 1.17 ac. Inches

Corresponding stage is between..... 10.00 and..... 10.50 navd

Interpolating gives a weir crest of..... 10.05 navd

iii) Compute exfiltration trench requirements for pre-treatment of pavement area

Impervious area.....	0.45 acres
Pretreatment based on 1/2 inch.....	0.02 acre ft.

iv) Compute required exfiltration trench volume 0.02 acre ft.

Required treatment in exfiltration trench is 0.10 ac.ft or 1.17 ac. inches

Average Hydraulic conductivity, K..... 9.40E-05


Top of trench elevation.....	7.80 navd
Bottom of trench elevation.....	3.80 navd
Trench width.....	5.0 ft
Trench height.....	4.0 ft
Pipe diameter.....	1.25 ft min.
Depth to water table.....	7.0 ft
Non saturated trench depth.....	4.0 ft
Saturated trench depth.....	3.8 ft
Trench storage area.....	10.61 sq.ft.

Trench length required for retention volume to be exfiltrated in 1 hour

Length required.....	79 ft
Associated average percolation rate.....	1.18 cfs

Length of trench to be used..... 140 l.f.

Associated average percolation rate.....	2.09 cfs or 0.17 ac.ft/hr
--	---------------------------

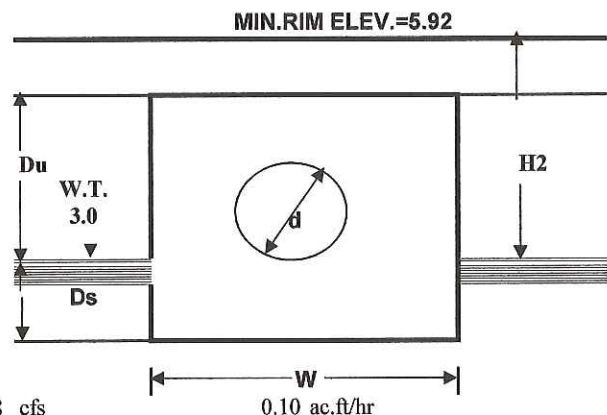

5) COMPUTE STAGE STORAGE

Assumptions:

Roads stores linearly from.....	10.00	to elevation.....	10.40	then vertically
Green areas store linearly from.....	10.00	to elevation.....	10.50	then vertically
Trench stores linearly from.....	3.00	to elevation.....	7.80	then vertically

Storage (acre ft.)					
Stage	Roads	Site	Trench**	Total	Stage
1.00	0.00	0.00	0.00	0.00	1.00
1.50	0.00	0.00	0.00	0.00	1.50
2.00	0.00	0.00	0.00	0.00	2.00
2.50	0.00	0.00	0.00	0.00	2.50
3.00	0.00	0.00	0.00	0.00	3.00
3.50	0.00	0.00	0.00	0.00	3.50
4.00	0.00	0.00	0.01	0.01	4.00
4.50	0.00	0.00	0.08	0.08	4.50
5.00	0.00	0.00	0.08	0.08	5.00
5.50	0.00	0.00	0.08	0.08	5.50
6.00	0.00	0.00	0.08	0.08	6.00
6.50	0.00	0.00	0.08	0.08	6.50
7.00	0.00	0.00	0.08	0.08	7.00
7.50	0.00	0.00	0.08	0.08	7.50
8.00	0.00	0.00	0.08	0.08	8.00
8.50	0.00	0.00	0.08	0.08	8.50
9.00	0.00	0.00	0.08	0.08	9.00
9.50	0.00	0.00	0.08	0.08	9.50
10.00	0.00	0.00	0.08	0.08	10.00
10.50	0.04	0.12	0.08	0.24	10.50
11.00	0.27	0.36	0.08	0.70	11.00
11.50	0.49	0.59	0.08	1.16	11.50
12.00	0.71	0.83	0.08	1.62	12.00
12.50	0.94	1.07	0.08	2.08	12.50
13.00	1.16	1.31	0.08	2.54	13.00
13.50	1.38	1.54	0.08	3.00	13.50
14.00	1.60	1.78	0.08	3.46	14.00
14.50	1.83	2.02	0.08	3.92	14.50
15.00	2.05	2.26	0.08	4.39	15.00
15.50	2.27	2.49	0.08	4.85	15.50
16.00	2.49	2.73	0.08	5.31	16.00
16.50	2.72	2.97	0.08	5.77	16.50
17.00	2.94	3.21	0.08	6.23	17.00

** Trench storage includes the first hour of trench discharge

6) FLOOD STAGE CRITERIA

5 Year 1 day Flood

5 year, 1 day storm	6.50 in.		
Runoff	3.73 in.		
Volume of runoff	0.30 acre ft.		
Corresponding stage is between.....	10.50 and.....	11.00	navd
Interpolating gives an elevation of.....	10.56	navd	

5 Year 1 hour Flood

5 year, 1 hour storm	3.10 in.		
Runoff	1.04 in.		
Volume of runoff	0.08 acre ft.		
Corresponding stage is between.....	10.00 and.....	10.50	navd
Interpolating gives an elevation of.....	10.01	navd	

25 Year 3 day Flood

25 year, 3 day storm	14.28 in.		
Runoff	10.96 in.		
Volume of runoff	0.89 acre ft.		
Corresponding stage is between.....	11.00 and.....	11.50	navd
Interpolating gives an elevation of.....	11.20	navd	

100 Year 3 day Flood

$Q = (P - (0.2xS))^2 / (P + (0.8xS))$			
100 year, 3 day storm	17.67 in.		
Runoff	14.24 in.		
Volume of runoff	1.15 acre ft.		
Corresponding stage is between.....	11.00 and.....	11.50	navd
Interpolating gives an elevation of.....	11.49	navd	